



RAUC(S) Apparatus Minimum Specification

Apparatus to be replaced or raised < 100mm above existing surface level

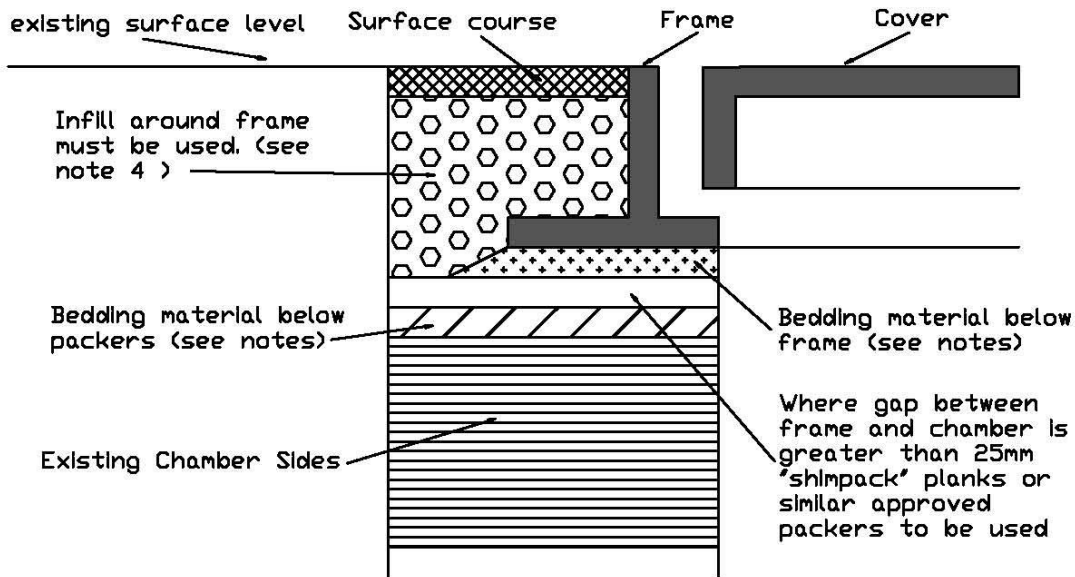

Apparatus to be replaced or raised > 100mm above existing surface level

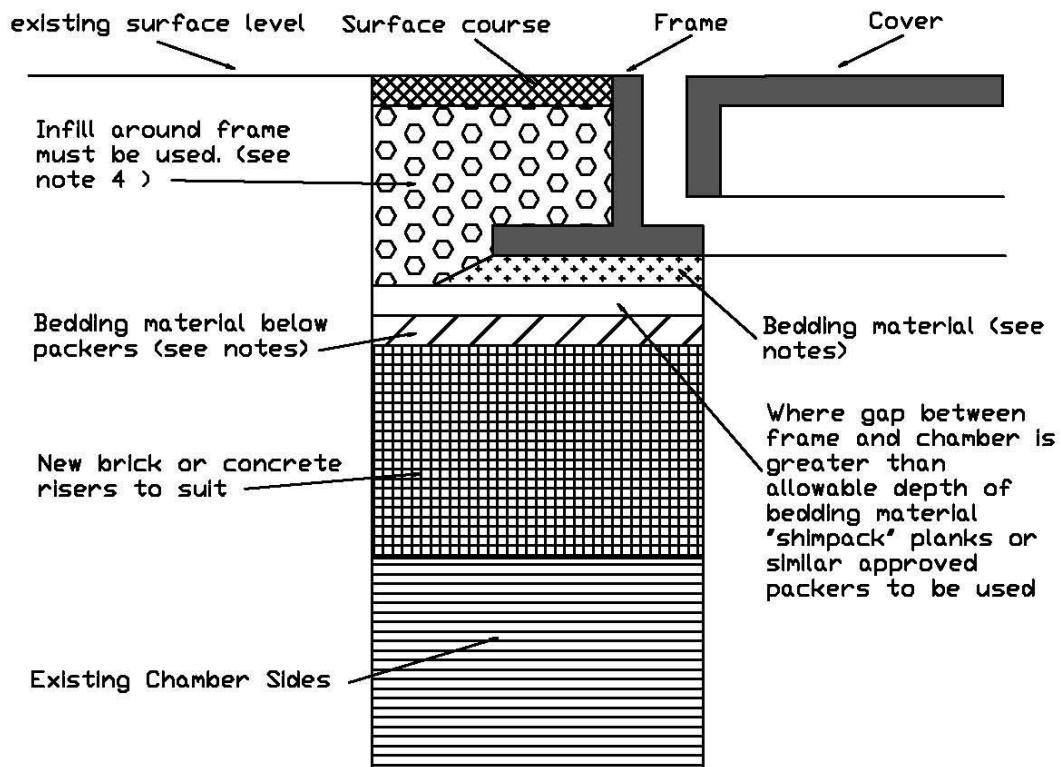

NOTES:

1. Alternative bedding material must be agreed between S.U. and R.A.
2. Polyester, epoxy or cementitious mortar to be propriety material with a minimum compressive strength of 20N/mm² within 2 hours.
3. Polyester, epoxy or cementitious mortar can be used for adjustments of not less than 10mm and not more than 25mm.
4. Infill around frame to be minimum C30 concrete or equivalent material.
5. Fireclay "scones" may still be used when raising Ironwork on footways only.